

ABANDONMENT OF SEPTIC TANK

- 1) Contents of septic tank must be pumped from tank and removed to appropriate depository. Pumping into public sewer system or onto an open area is not an acceptable procedure.
- 2) Septic tank lid must be removed or crushed in.
- 3) Leach line and inlet must be plugged, though leach line and leach field may be left in place.
- 4) Three 4" diameter holes should be put in the bottom of the septic tank to allow for proper drainage.
- 5) Septic tank must be filled with approved granular material.

WEST VALLEY SANITATION DISTRICT OF SANTA CLARA COUNTY

**ABANDONED SEPTIC TANK**

S.S.A.P.


SCALE  
NONE

DRAWN  
D. TOY

CHECKED  
*LEE*

APPROVED *William A. Jessler*  
DATE: 7-28-89 MANAGER AND ENGINEER

DRAWING

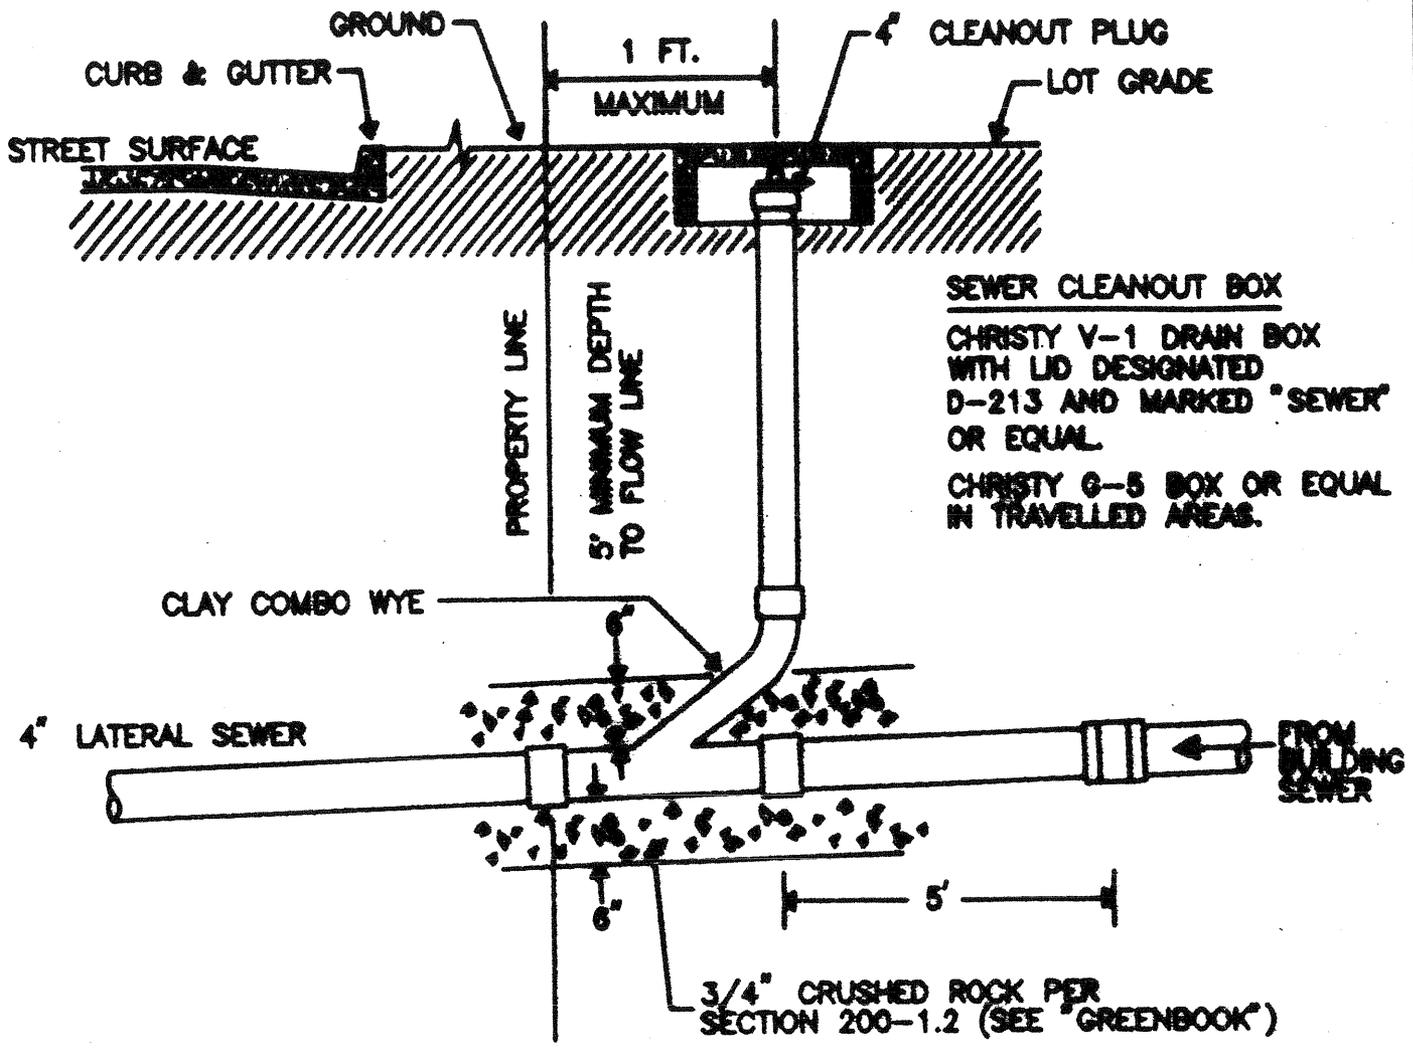


SANITARY SEWER PROPERTY LINE CLEANOUT WYE AND STACK MUST BE SAME MATERIAL AS LATERAL SEWER.

# CLAY PIPE

WEST VALLEY SANITATION DISTRICT  
OF SANTA CLARA COUNTY

## STANDARD SEWER LATERAL CLEANOUT

SCALE	DRAWN BY	CHECKED BY	APPROVED BY:	DRAWING
NONE	D. CONWAY	<i>[Signature]</i>	<i>[Signature]</i> DATE: 1/7/21 DISTRICT MANAGER/ENGINEER	NO. 3A

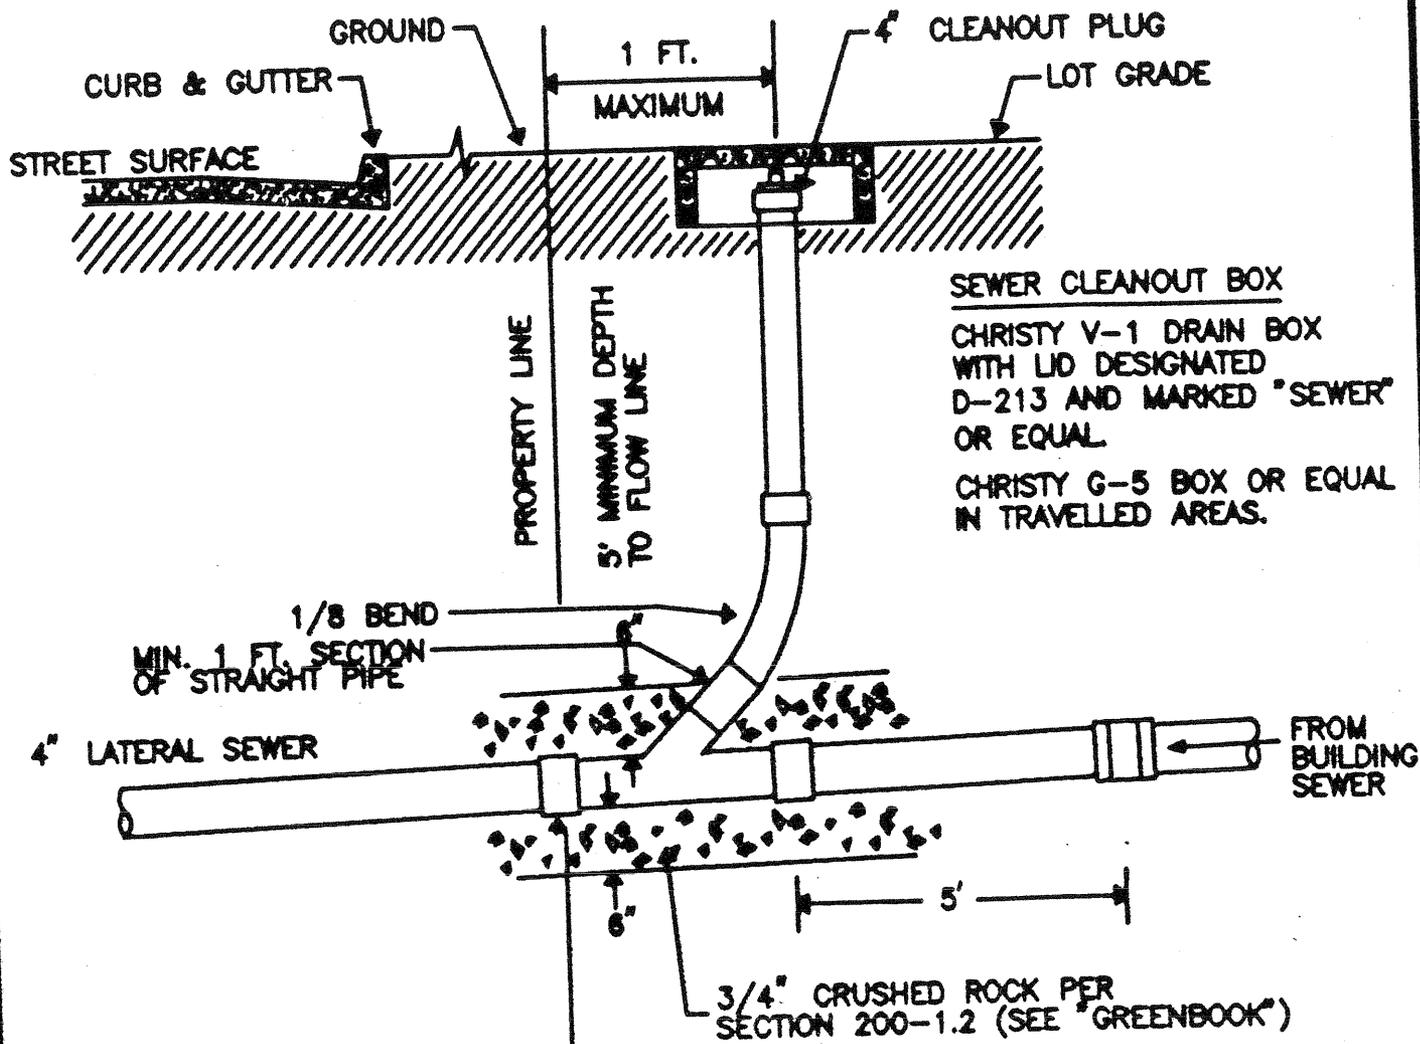

SANITARY SEWER PROPERTY LINE CLEANOUT WYE AND STACK MUST BE SAME MATERIAL AS LATERAL SEWER.


- \* NO PLASTIC COMBOS ALLOWED.
- \* ACCEPTABLE PLASTIC PIPE:
  - ABS SDR 23.5
  - PVC SDR 26 (OR BETTER) WITH SDR 35 FITTINGS

## PLASTIC PIPE

WEST VALLEY SANITATION DISTRICT  
OF SANTA CLARA COUNTY

# STANDARD SEWER LATERAL CLEANOUT

SCALE	DRAWN BY	CHECKED BY	APPROVED BY:	DRAWING
NONE	D. CONWAY	LEE	DATE: 11/7/92 <i>R. [Signature]</i> DISTRICT MANAGER/ENGINEER	NO. 3B

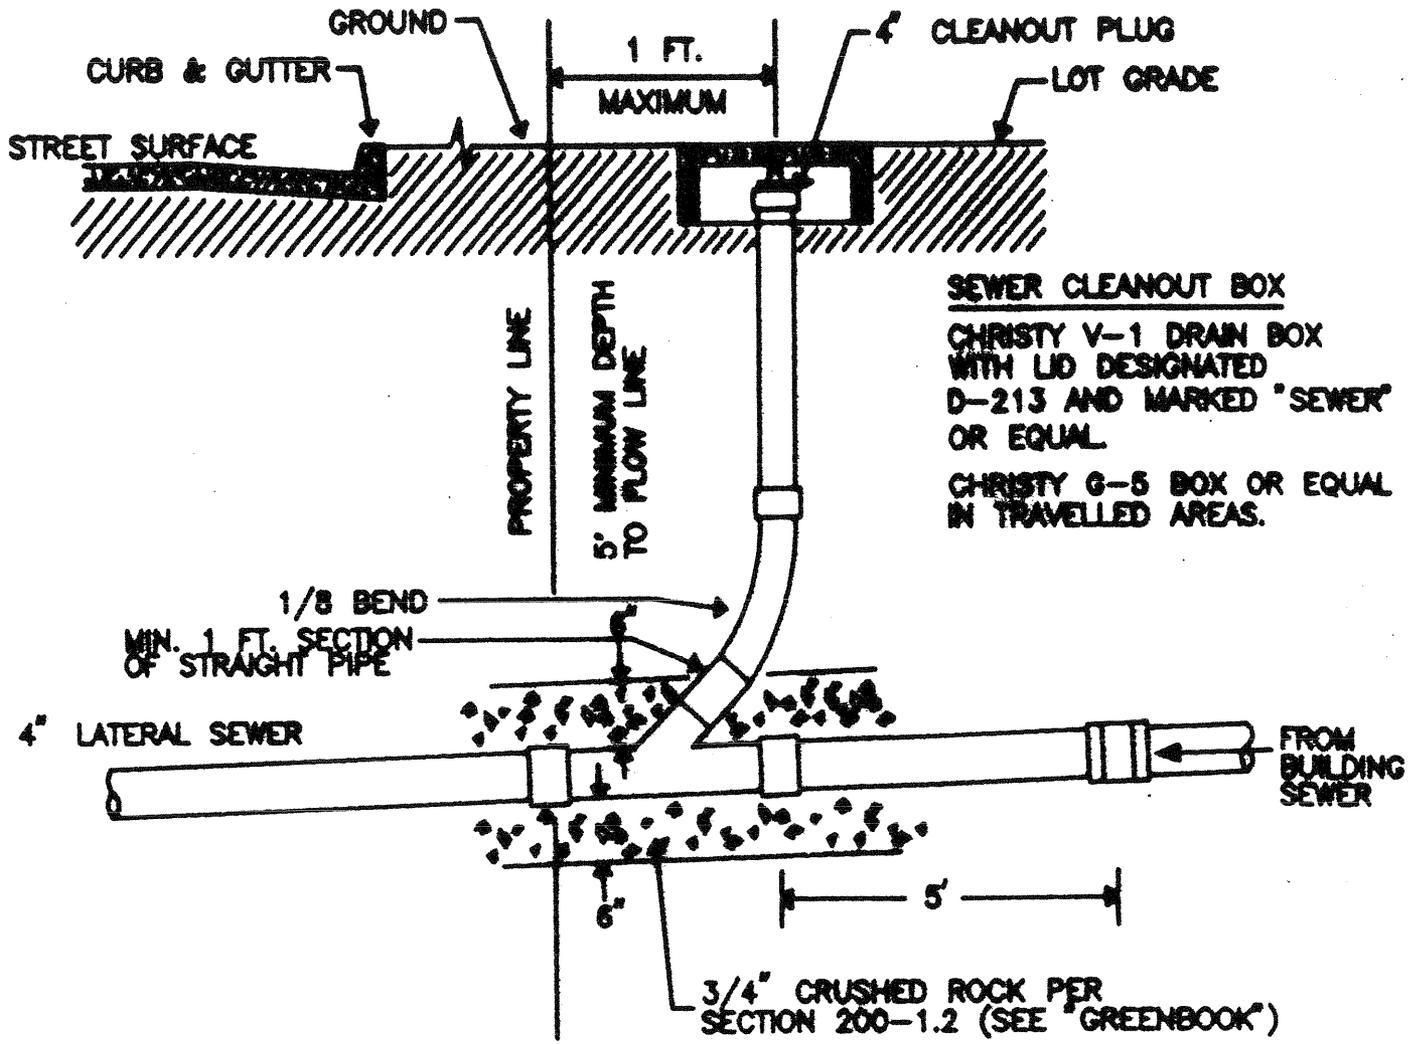

SANITARY SEWER PROPERTY LINE CLEANOUT WYE AND STACK MUST BE SAME MATERIAL AS LATERAL SEWER.

- \* ACCEPTABLE IRON PIPE:
- DUCTILE IRON (CLASS 51 OR BETTER)
- CAST IRON (FOR CLEANOUTS ONLY)

## IRON PIPE

WEST VALLEY SANITATION DISTRICT  
OF SANTA CLARA COUNTY

# STANDARD SEWER LATERAL CLEANOUT

SCALE	DRAWN BY	CHECKED BY	APPROVED BY:	DRAWING
NONE	D. CONWAY	<i>lee</i>	<i>R. [Signature]</i> DISTRICT MANAGER/ENGINEER	NO. 3C
			DATE: 1/7/97	